

**COUNTY OF SAN MATEO DEPARTMENT  
OF**


DRAWN BY: A.Z.  
 CHECKED BY: K.L.  
 APPROVED BY: A.M.S.

**PUBLIC WORKS**




REDWOOD CITY  
CALIFORNIA


SCALE: NONE  
 DATE: 2-2022  
 REVISED: 2-2022

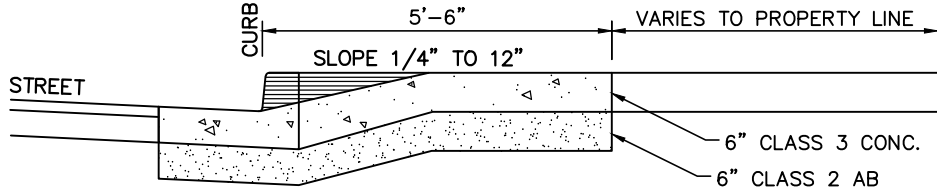

**SECTION**

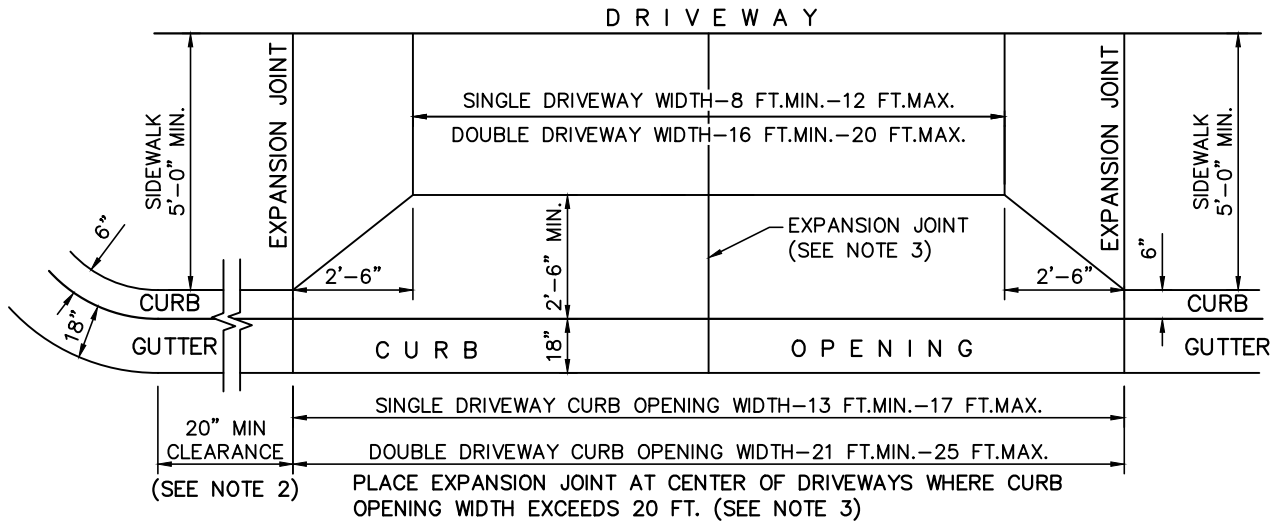

**PLAN**

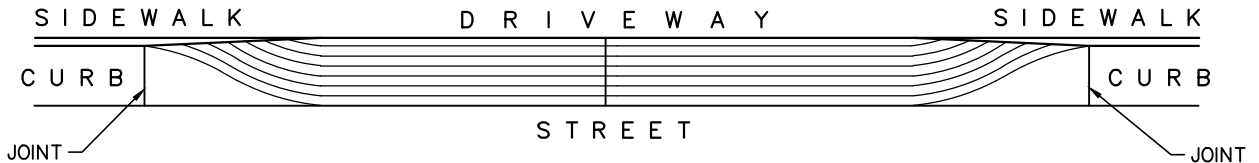

**ELEVATION**

**NOTES:**

- WHERE POSSIBLE, 22 FT. DISTANCES OR MULTIPLES OF 22 FT. DISTANCES SHOULD BE OBTAINED BETWEEN CURB OPENINGS. CONSTRUCT MONOLITHIC CURB, GUTTER, DRIVEWAY AND APRON. WHERE DRIVEWAYS OF SEPARATE RESIDENTIAL DWELLINGS ARE CONSTRUCTED ADJACENT TO ONE ANOTHER, DOUBLE THE DIMENSIONS SHOWN ABOVE. USE NO. 4 SMOOTH REINFORCING BAR DOWELS AS SHOWN ON STANDARD CURB, GUTTER AND SIDEWALK DETAIL D-3.
- EXISTING DRIVEWAYS MAY BE REPLACED AT EXISTING LOCATIONS, HOWEVER NEW OR NEWLY LOCATED DRIVEWAY MUST BE OFFSET A MIN OF 20 FT FROM THE END OF RETURN.
- EXPANSION JOINT FELT, NO FOAM OR OTHER MATERIAL. FELT 1/4" - 1/2" MAX. THICKNESS.

**STANDARD STRUCTURES  
 DRIVEWAY WIDTHS AND CURB OPENINGS  
 FOR SINGLE FAMILY RESIDENTIAL DWELLINGS**